


CORRECTOR RACKS FOR PERIOD 24

STEPS FOR RACK MOVE

[illegible]

1. EMPTY RACKS G24-RR5-2 AND -3.
2. SUBMIT REQUEST FOR 4 HOURS OF SHUTDOWN WORK FOR THE FOLLOWING.
3. ELECTRICIANS ARE TO REMOVE AC TO RACKS G24-RR5-2 AND -3 AND MODIFY THE AC CONDUIT TO G24-RR5-1 SO THIS RACK AND THE 3-RACK BASE CAN BE ROTATED TO THE NEW POSITION.
4. ROTATE G24-RR5-1 AND 3-RACK BASE TO NEW POSITION.
5. ELECTRICIANS COMPLETE MODIFICATION TO THE AC CONDUIT FOR G24-RR5-1.

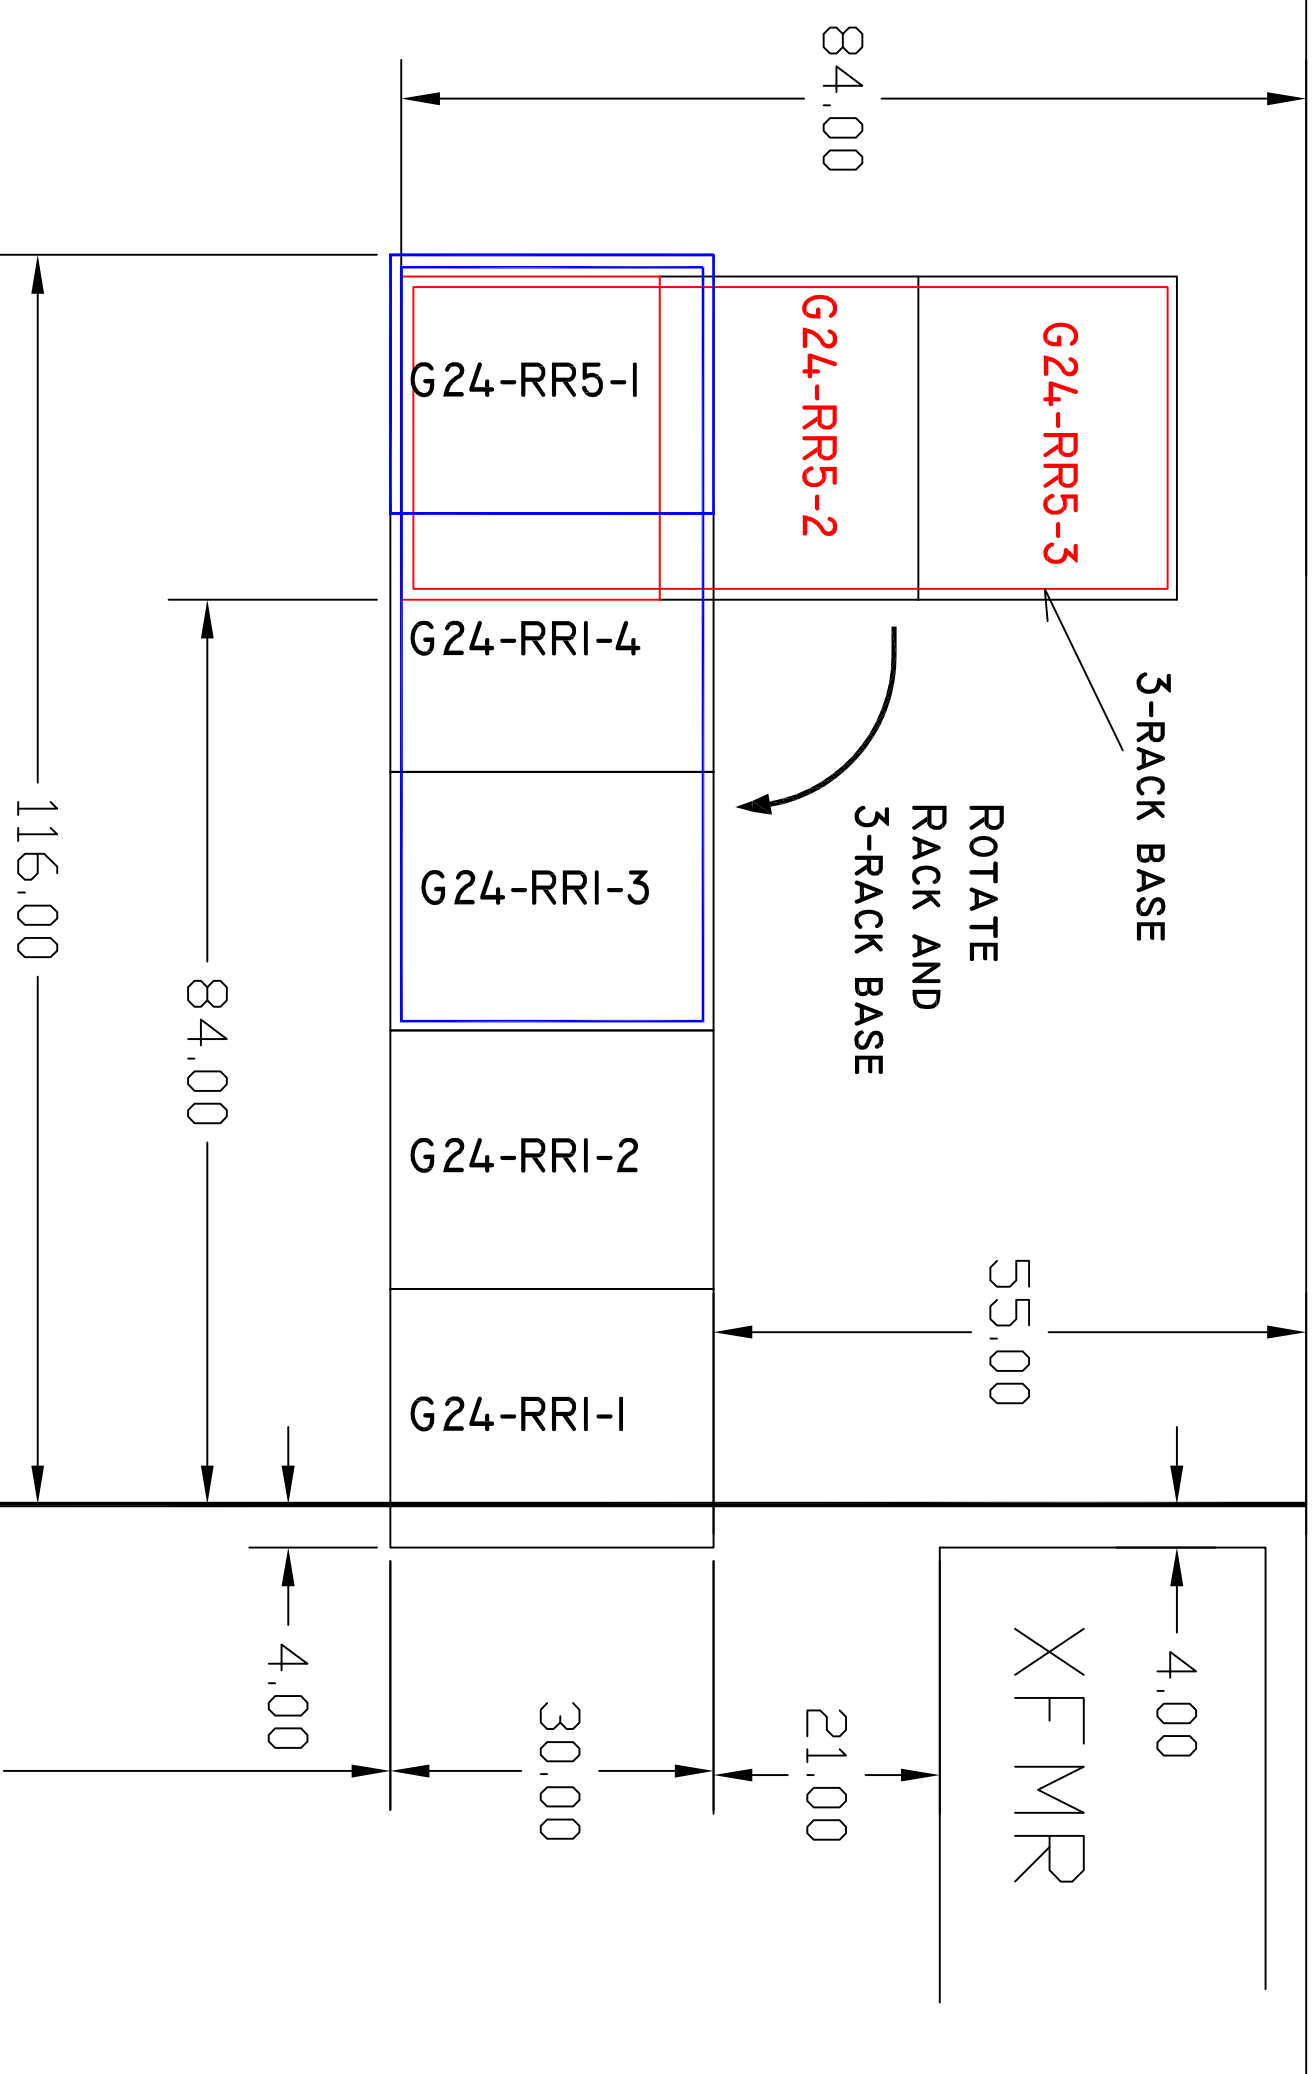

IF YOU HAVE CORRECTIONS OR CONCERNS WITH THIS RACK MODIFICATION

PLEASE CONTACT CRAIG DRENNAN

CDRENNAN@FNAL.GOV

X2160

WALL